




**UTILITY SUPPLIED POLE MOUNTED
OVERHEAD METER ASSEMBLY,
RESIDENTIAL, 200 AMP RATED**

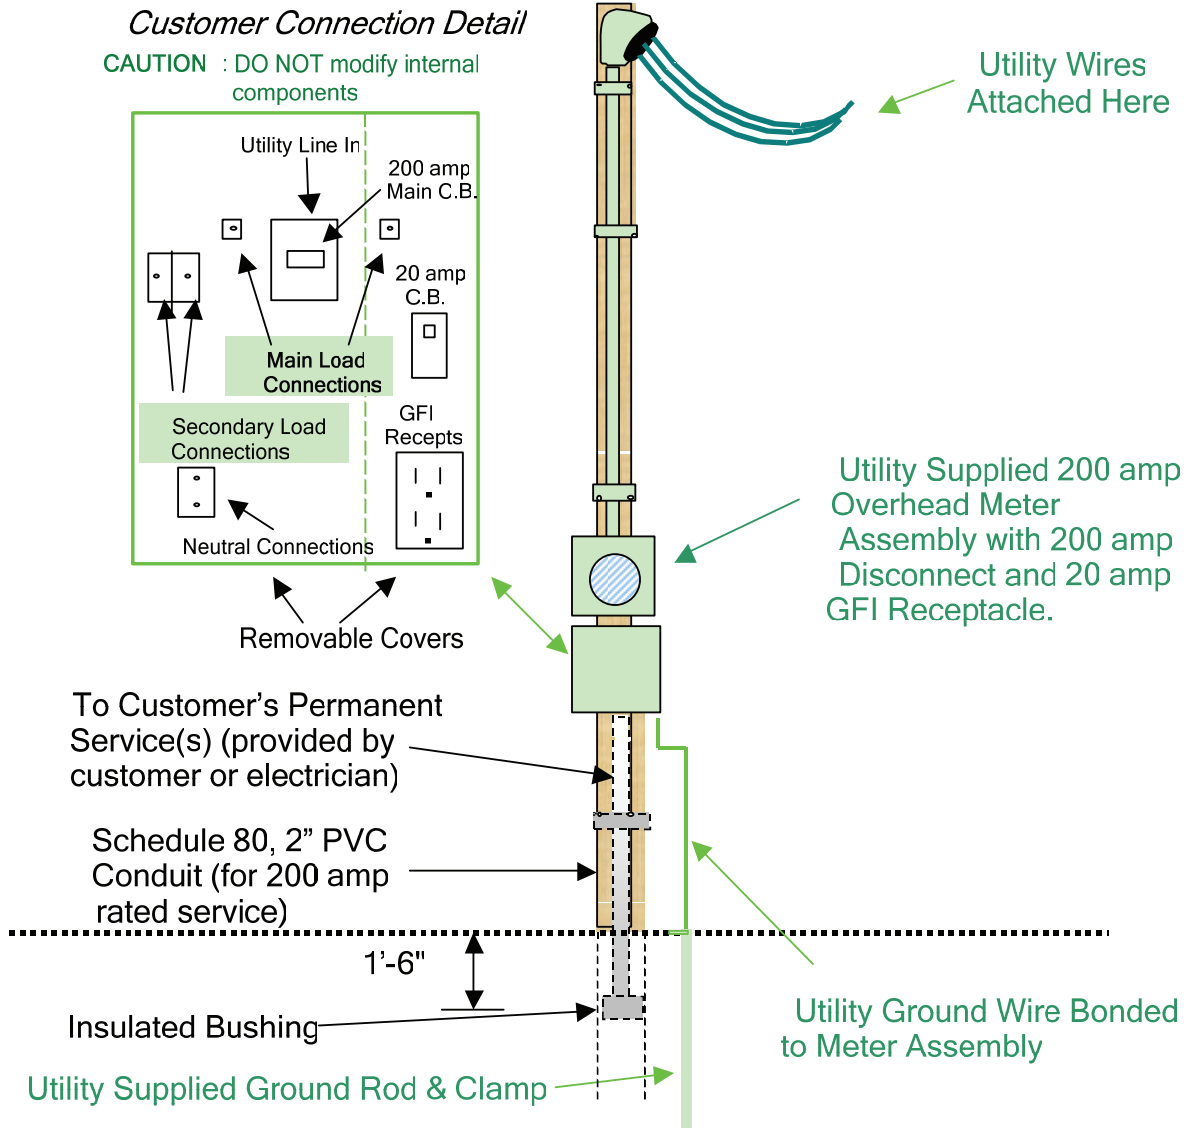


Notes:


Crow Wing Power retains ownership of Utility supplied meter assembly. **DO NOT modify any internal components.** There is a \$300 Meter Entrance Charge for this assembly. All Customer connections and/or services attached to the CWP meter assembly must be approved by the Minnesota State Board of Electricity. Consult with the State Wiring Inspector BEFORE hooking up to a Manufactured or Mobile Home. Web-site: <http://www.electricity.state.mn.us/>

TYPICAL APPLICATIONS

Overhead Service to Meter On Pole to “Stick Built” House

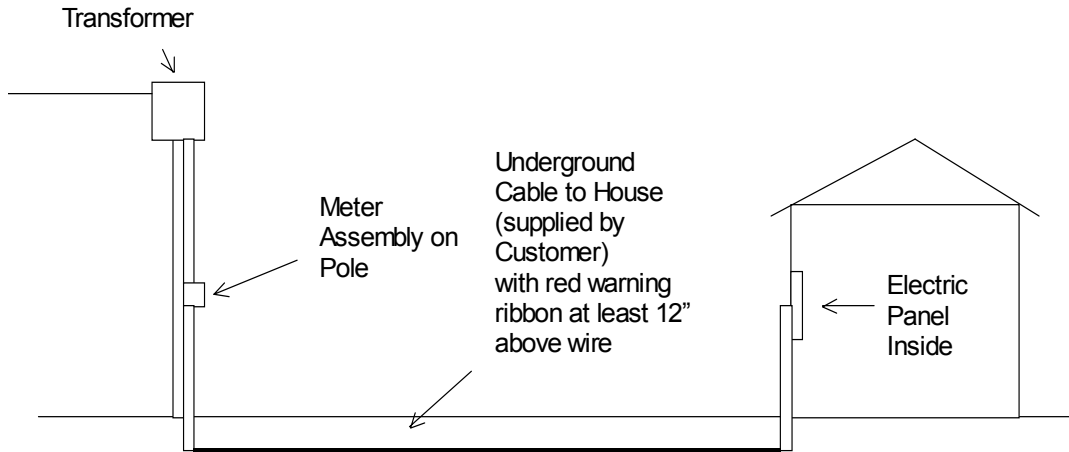

Overhead Service to Meter On Pole to “Manufactured” House

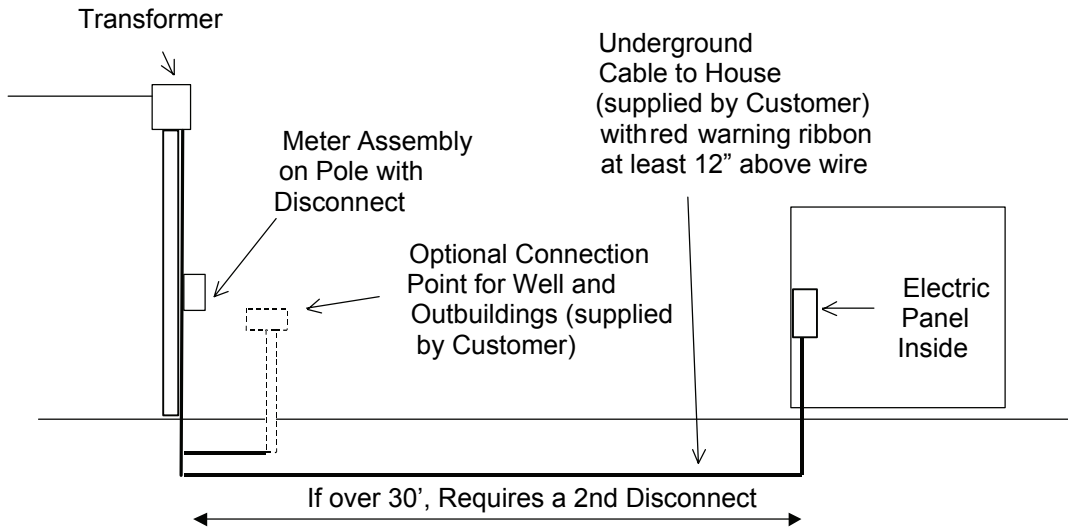

- Customer supplied wiring from the load side of the meter equipment must be sized in accordance with the National Electric Code.
- Wire size of a residential single phase dwelling service can be sized using the table notes for Article 310:15 (B)(6).
- Any secondary residential type service for heating or air conditioning (continuous duty service) are not subject to derating and must be sized from table 310:16. This is for both direct and subtractive metering.
- Red warning ribbon is placed at least 12" above underground wiring.