




CUSTOMER SUPPLIED PEDESTAL MOUNTED UNDERGROUND METER ASSEMBLY, RESIDENTIAL, 200 AMP RATED

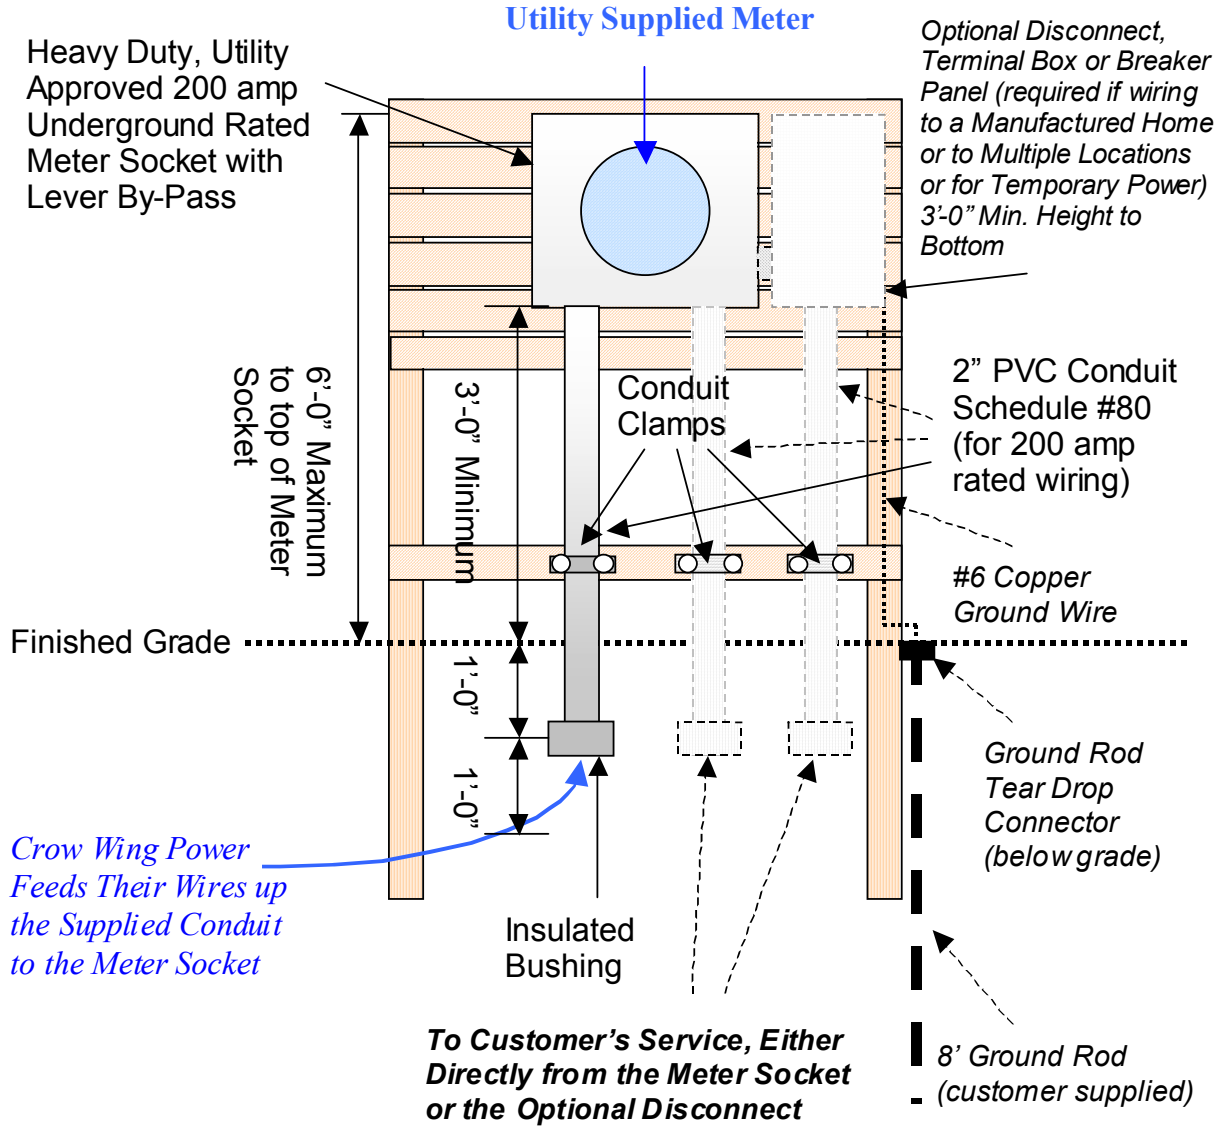

Notes:

- All meter assemblies must be approved by the Minnesota State Board of Electricity prior to energizing by Crow Wing Power.
- Lumber to be either fully treated or rot resistant wood such as redwood or cedar.
- Uprights shall be minimum 4"x 4" size placed 2'-3' in the ground to avoid frost shifting.
- Backing material should be minimum 3/4" thickness.
- Hardware to be rust resistant.
- Consult with the State Wiring Inspector BEFORE hooking up to a Manufactured or Mobile Home.