



**Member Supplied Pole Mounted Overhead Meter Assembly
 Residential 200 Amp Rated for Upgraded or Repaired Existing Services Only
 N.A. for New Electric Services**

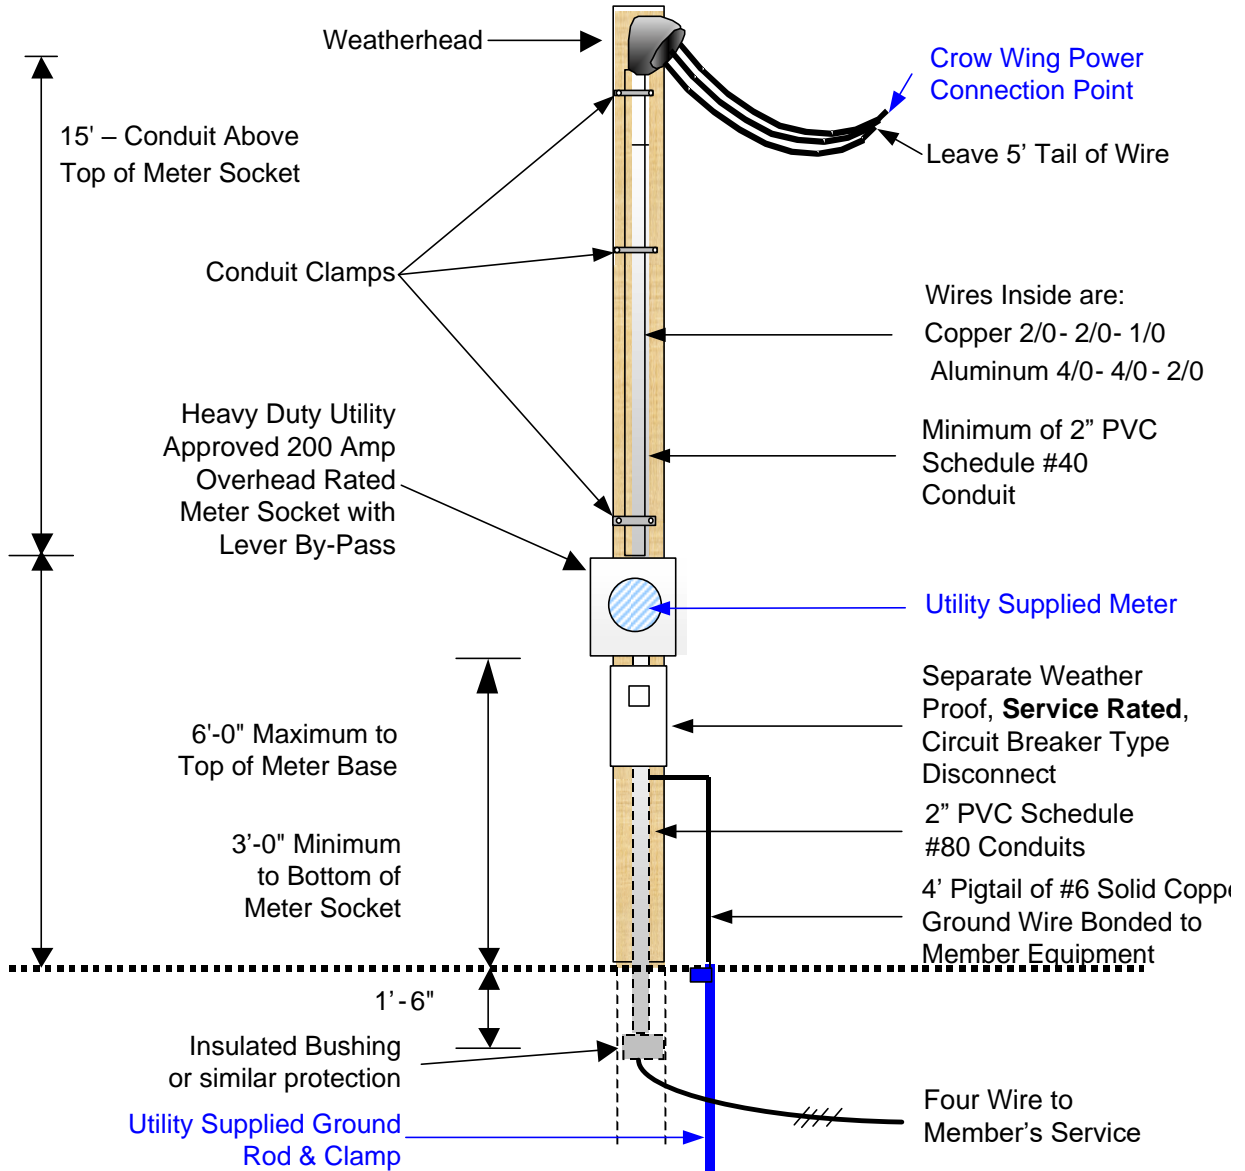

Notes:

All meter assemblies must be approved by the Minnesota State Board of Electricity prior to energizing by Crow Wing Power. **Please refer to the Crow Wing Power, Metering and Energy Management Control Standards book.** Consult with the State Wiring Inspector **BEFORE** hooking up to a Manufactured or Mobile Home.

Typical Applications

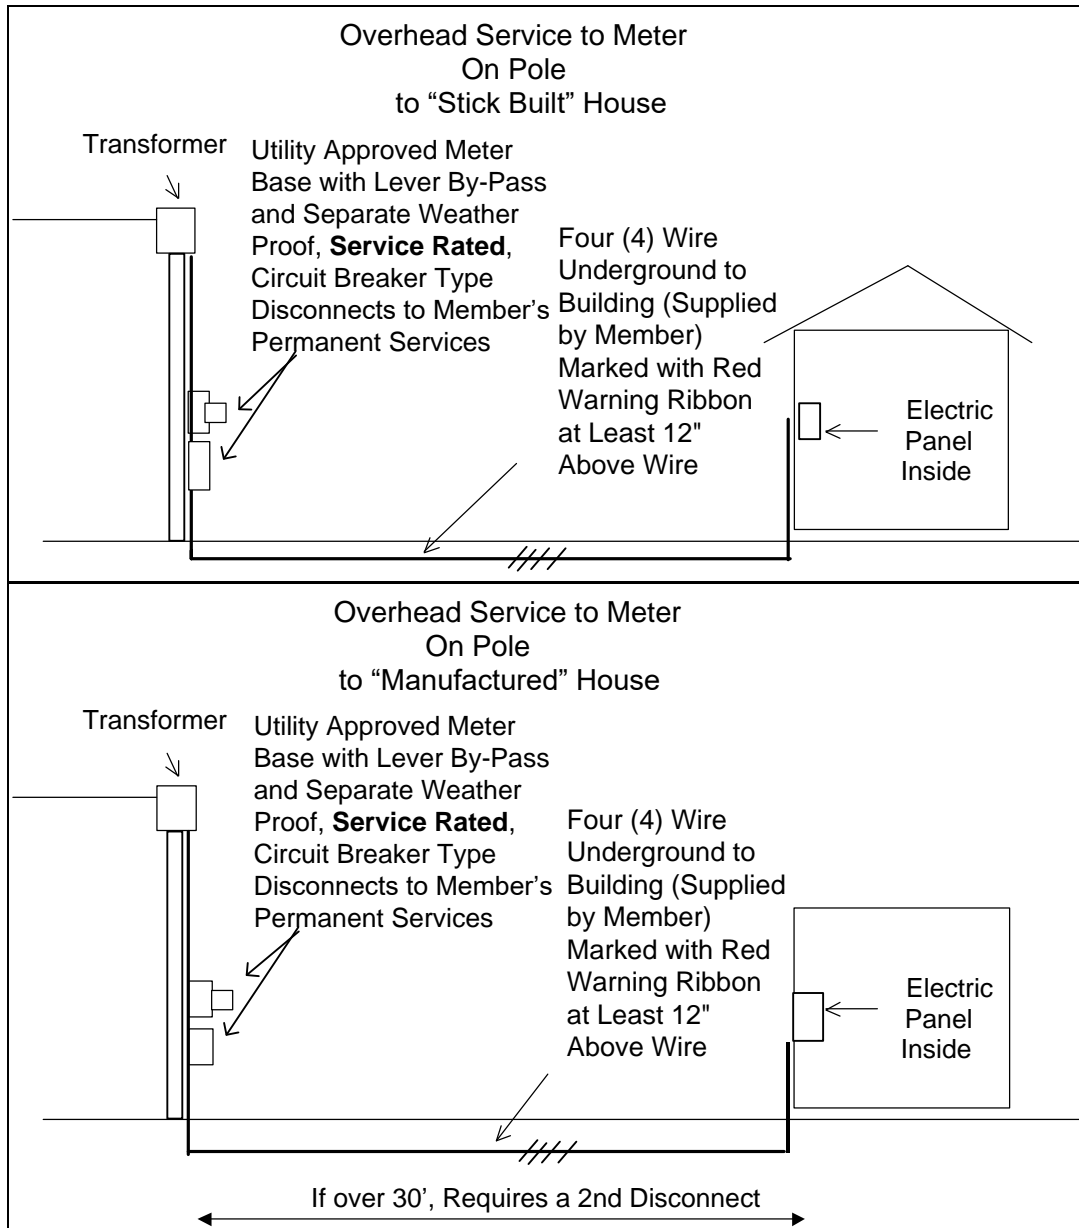

- **PLEASE NOTE:** Applicable to upgraded or repaired existing services ONLY. New Electric Services must utilize Crow Wing Power furnished Meter Assemblies
- Customer supplied wiring from the load side of the meter equipment must be sized in accordance with the National Electric Code.
- An approved disconnect on the load (customer) side of the meter socket is required. Disconnects are separate from (not integrated into) the meter socket.



PO Box 507
Hwy 371 North Brainerd, MN 56401
www.cwpower.com
218-829-2827 1-800-648-9401

- Wire size of a residential single phase dwelling service can be sized using the table notes for Article 310:15 (B)(6). This includes a separate, dedicated ground wire.
- Any secondary residential type service for heating or air conditioning (continuous duty service) is not subject to derating and must be sized from table 310:16. This is for both direct and subtractive metering.
- Red warning ribbon is placed at least 12" above underground wiring.